ALL RIGHTS RESERVED NO PART OF THIS MAP MAY BE REPRODUCED IN ANY FORM WITHOUT WRITTEN PERMISSION FROM THE SANBORN MAP COMPANY

(11 Sheets)

1

SANBORN MAP COMPANY

POPULATION 29000

PREVAILING WINDS WESTERLY

WATER FACILITIES EXCELLENT

CENTER LINE

MACOMB COUNTY

MICHIGAN

JULY 1932

NEW YORK

PASTE OVER ORIGINAL REPORT

CENTER LINE, MICH.

NEW REPORT, MAY, 1941

POPULATION: 4,000

PAVING: Van Dyke Ave., Ten Mile Road, Eleven Mile Road, Warren Boulevard and Sherwood Ave. concrete paved.

GRADES: Level.

WATER FACILITIES

Owned and operated by Village. Source from 2 deep wells, 122' deep, located in pump house, s. Wyland St. and Ten Mile Road. Gravity and direct pressure system. 1 American deep well turbine pump (electric), capacity 500 gallons per minute. 1 Worthington deep well pump (electric) capacity 200 gallons per minute. One 100,000 gallon water tank located at pump house, elevated 90' above business section.

15 miles 6" to 8" water pipes. 78 double hydrants. Average daily consumption 85,000 gallons. Average pressure 55 lbs.

FIRE DEPARTMENT

2 chiefs, fully paid, 1 on each 24 hour shift. 16 volunteers, paid by call. 1 station.

1 American LaFrance triple combination auto, 750 gallon capacity engine, one 160 gallon booster tank and hose, 1,250' 2½" hose. 1 Dodge truck with 500 gallon per minute pump, 200 gallon booster tank, 1,000' 2½" hose, one 30' and one 45' ladder. 1,350' 2½" hose in reserve, one 24' extension and two 12' roof ladders.

Alarm by telephone and siren.

NO FIRE-RESISTIVE ROOFING ORDINANCE.

WARREN TOWNSHIP

Including VAN DYKE and BASE LINE

POPULATION: Approximately 25,000

PAVING: Eight Mile Road, Nine Mile Road, Twelve Mile Road and Van Dyke Ave. concrete paved. Others not marked unpaved are cinders or gravel.

GRADES: Level.

WATER FACILITIES

Operated, owned and laid by Township. City of Detroit.

52 miles of 6" to 24" water pipes. 317 do Daily consumption approximately 125,000 gall pressure 80 lbs.

26 miles of water mains and 125 hydrants, in 1941.

FIRE DEPARTMENT

2 fully paid men. 12 volunteers, paid by c 1 Dodge truck with 500 gallon per minute pu booster tank, 1,000' 2½" hose and 250' 1" hose.

All towns in Township have working agreem other in case of emergency by fire.

No Fire Limits.
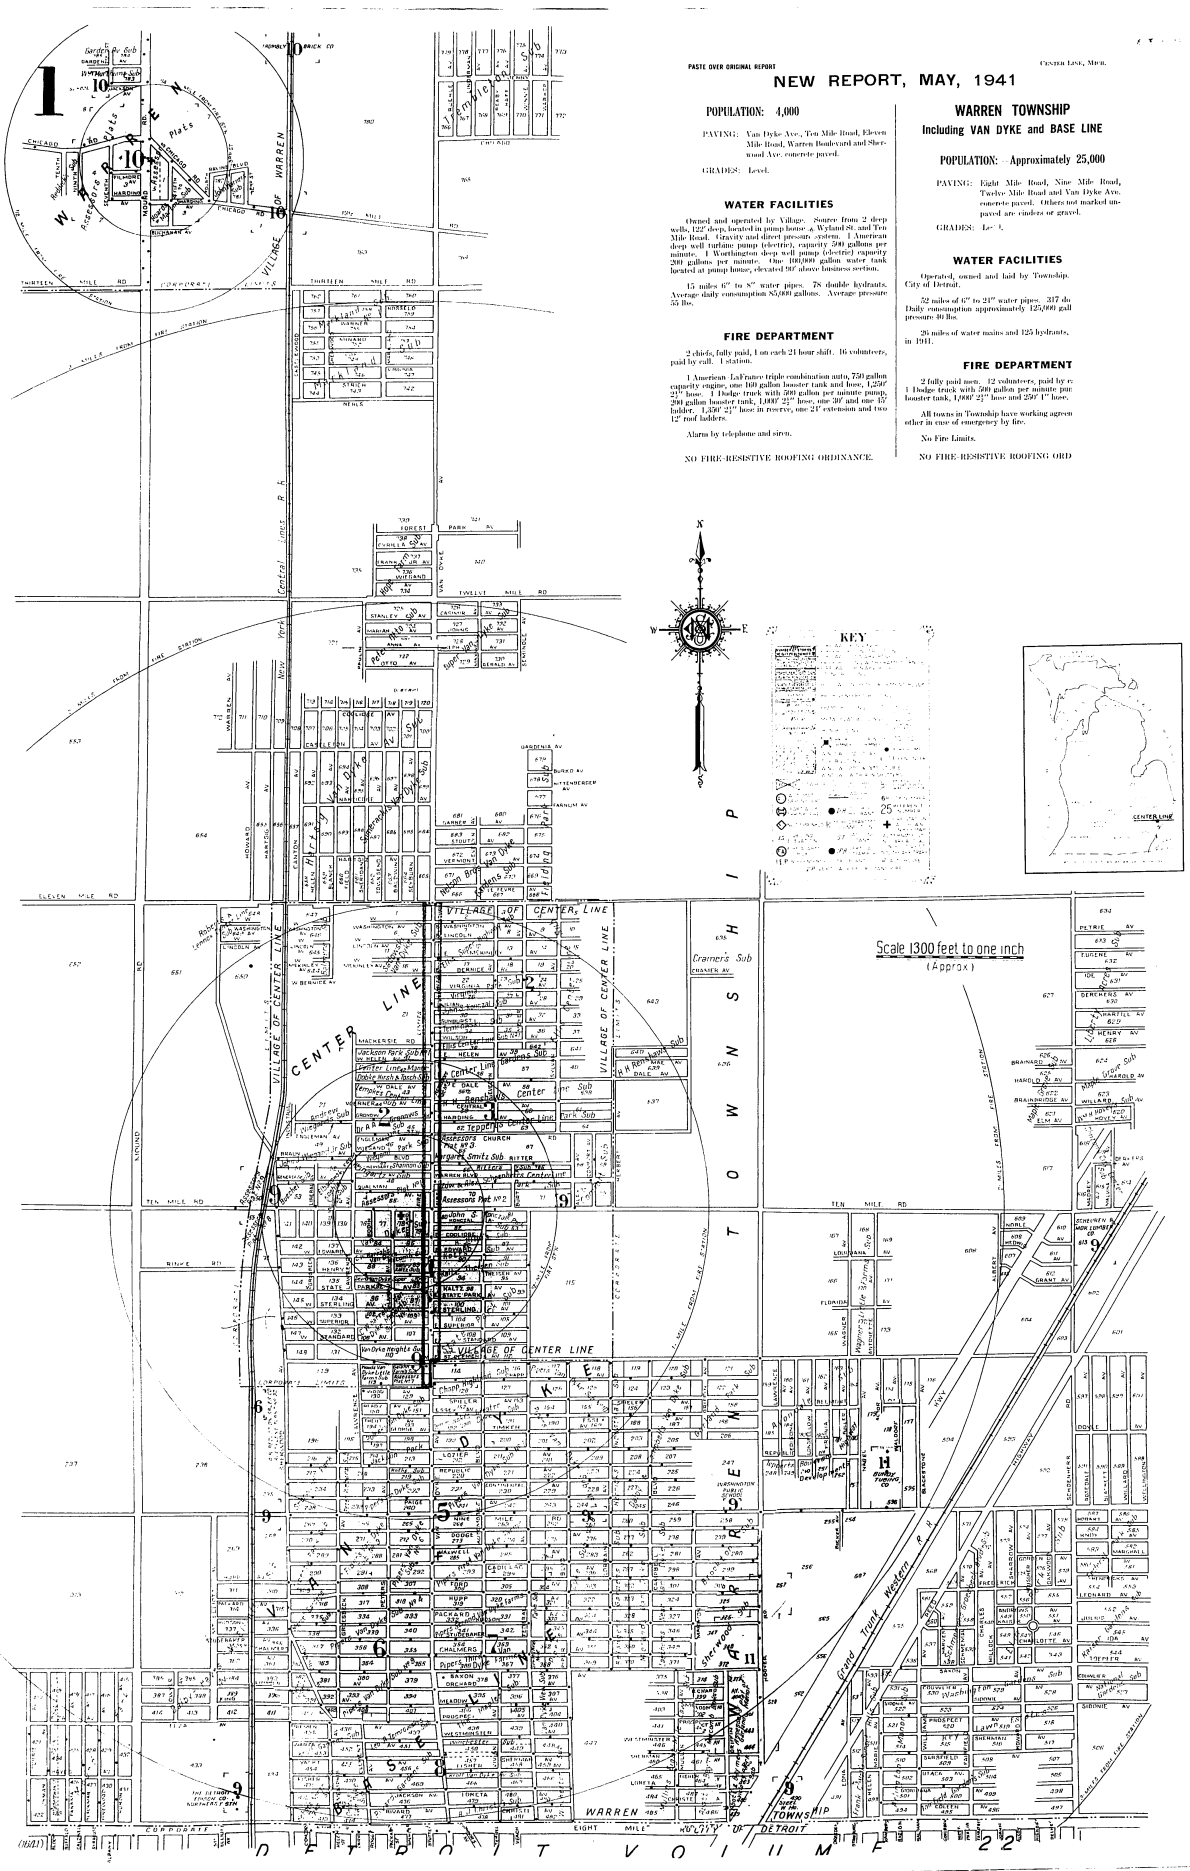
NO FIRE-RESISTIVE ROOFING ORD